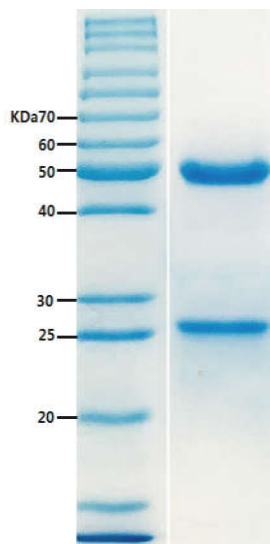
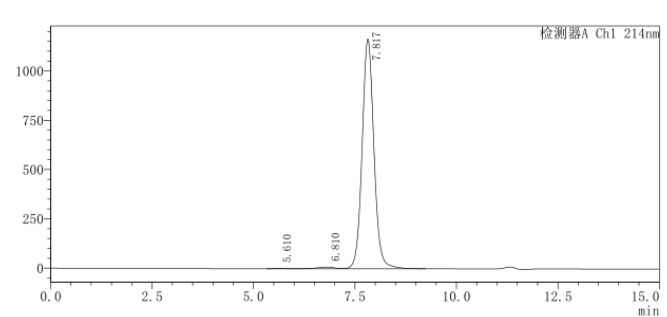


CERTIFICATE OF ANALYSIS			
<b>Name</b>	anti-HEL-Human IgG1 LALA Isotype-control	<b>Catalog Number</b>	B109802
<b>Label Type</b>	Human IgG1 LALA-Kappa	<b>Host</b>	HEK293

QC Results			
Test Items	Specifications		Results
<b>Purity</b>	>95%, by SDS-PAGE under reducing conditions.		Pass
	98.822%, by SEC-HPLC test.		Pass
<b>Endotoxin</b>	<1 EU/mg as determined by LAL test.		Pass
<b>ELISA Binding</b>	Measured its binding ability with Hen egg Lysozyme in a binding ELISA.		Pass
<b>Biacore</b>	ka (1/Ms)	kd(1/s)	KD (M)
	5.57E+06	3.58E-06	6.433E-13

### QC Data


### SDS-PAGE and SEC-HPLC

M	1																									
 <p>LaneM: Marker Lane1: Reducing of B109802</p>	 <table border="1"> <thead> <tr> <th>峰号</th> <th>保留时间</th> <th>面积</th> <th>高度</th> <th>面积%</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>5.610</td> <td>25230</td> <td>1613</td> <td>0.105</td> </tr> <tr> <td>2</td> <td>6.810</td> <td>256853</td> <td>8720</td> <td>1.073</td> </tr> <tr> <td>3</td> <td>7.817</td> <td>23654443</td> <td>1166234</td> <td>98.822</td> </tr> <tr> <td>总计</td> <td></td> <td>23936526</td> <td>1176567</td> <td>100.000</td> </tr> </tbody> </table>	峰号	保留时间	面积	高度	面积%	1	5.610	25230	1613	0.105	2	6.810	256853	8720	1.073	3	7.817	23654443	1166234	98.822	总计		23936526	1176567	100.000
峰号	保留时间	面积	高度	面积%																						
1	5.610	25230	1613	0.105																						
2	6.810	256853	8720	1.073																						
3	7.817	23654443	1166234	98.822																						
总计		23936526	1176567	100.000																						

CONFIDENTIAL

Biointron Biological Inc.

CERTIFICATE OF ANALYSIS			
<b>Name</b>	anti-HEL-Human IgG1 LALA Isotype-control	<b>Catalog Number</b>	B109802
<b>Label Type</b>	Human IgG1 LALA-Kappa	<b>Host</b>	HEK293

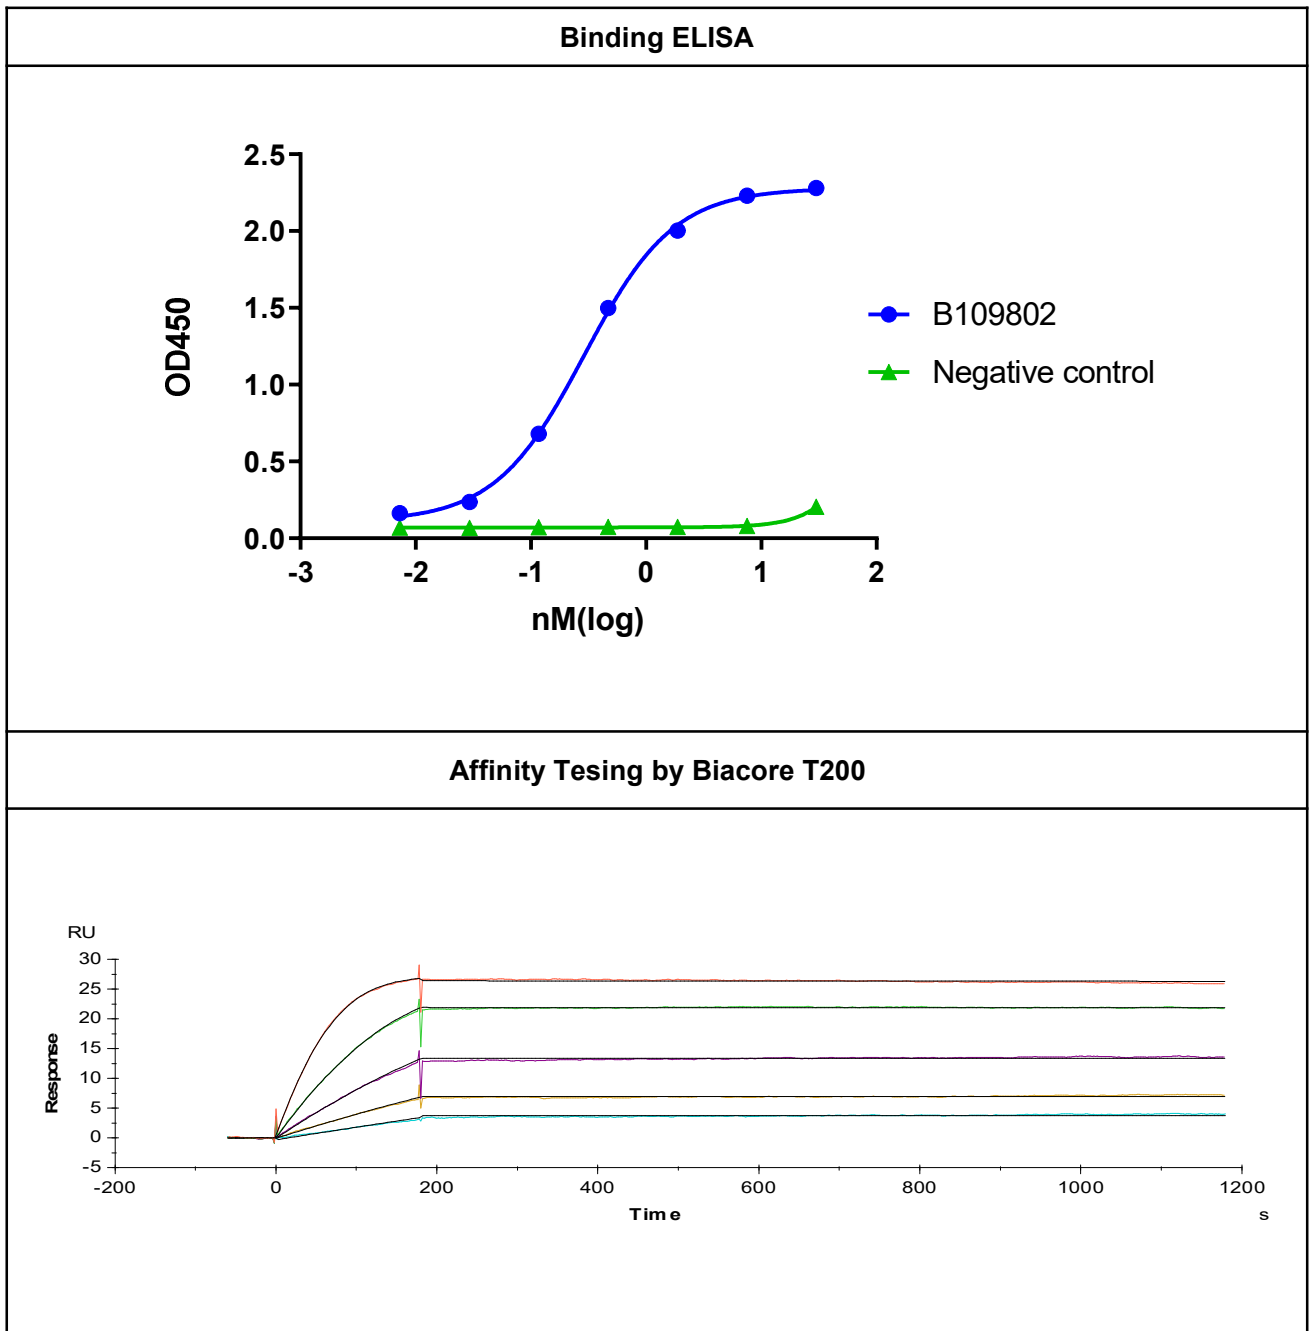

CONFIDENTIAL

Biointron Biological Inc.

Web: <http://www.biointron.com/en> TEL: +86-400-828-8830 E-mail: [info@biointron.com](mailto:info@biointron.com) Address: Factory G25-4, China Medical City, Taizhou, Jiangsu Province, China